


NOTES

1. CONCRETE TESTING, 3000 LBS. MIN. PER SQ/IN;  
4% TO 6% ENTRAINED AIR, 3/4" MAX. SIZE AGGREGATE.
2. #4 REINFORCING STEEL, ATSM-A615 GRADE 60, PLACE APPROX. 6" O.C. EACH WAY AND SECURELY TIED TOGETHER.
3. MINIMUM CONCRETE COVER OVER REINFORCING STEEL 2" UNLESS NOTED.
4. WOOD FLOAT FINISH, LEAVING NO DEPRESSION.

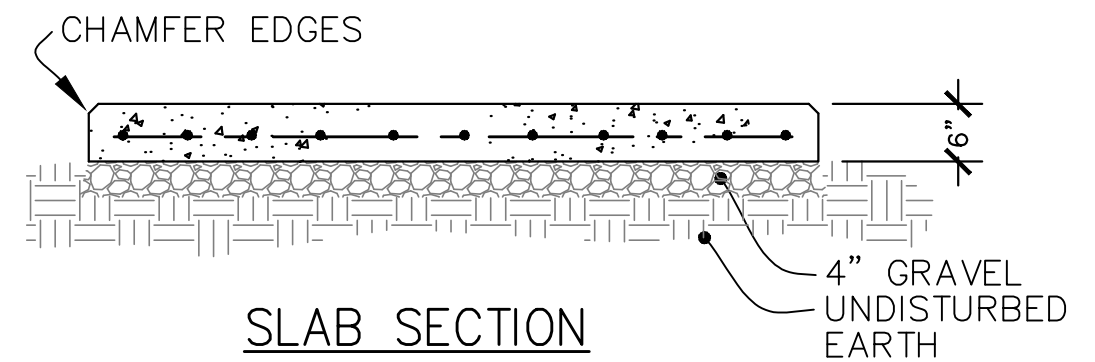

○ — TRANSFORMER PAD 75 TO 500 KVA  
NTS