


SLAB PLAN

○ — TRANSFORMER PAD 750 TO 2500 KVA
NTS

NOTES

1. CONCRETE TESTING, 3000 LBS. MIN. PER SQ/IN;
4% TO 6% ENTRAINED AIR, 3/4" MAX. SIZE
AGGREGATE.
2. #4 REINFORCING STEEL, ATSM-A615 GRADE 60, PLACE
APPROX. 6" O.C. EACH WAY AND SECURELY TIED
TOGETHER.
3. MINIMUM CONCRETE COVER OVER REINFORCING STEEL
2" UNLESS NOTED.
4. WOOD FLOAT FINISH, LEAVING NO DEPRESSION.

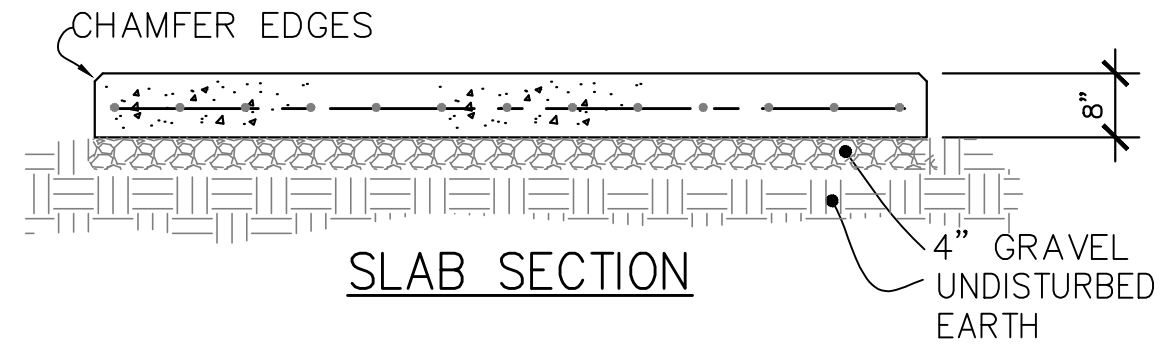

SLAB SECTION