



SLAB PLAN

NOTES

1. CONCRETE TESTING, 3000 LBS. MIN. PER SQ/IN; 4% TO 6% ENTRAINED AIR, 3/4" MAX. SIZE AGGREGATE.
2. #4 REINFORCING STEEL, ATSM-A615 GRADE 60, PLACE APPROX. 6" O.C. EACH WAY AND SECURELY TIED TOGETHER.
3. MINIMUM CONCRETE COVER OVER REINFORCING STEEL 2" UNLESS NOTED.
4. WOOD FLOAT FINISH, LEAVING NO DEPRESSION.

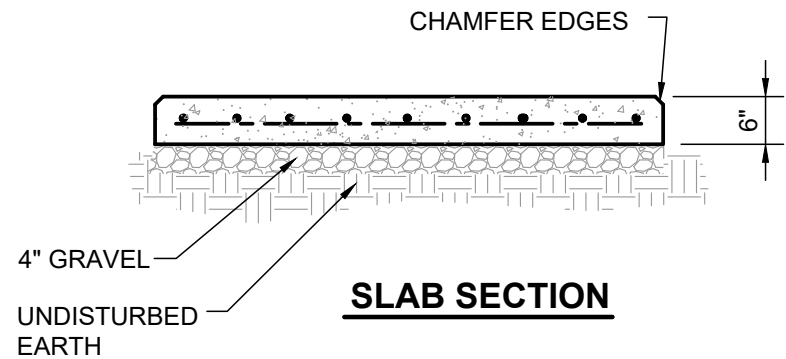

SLAB SECTION



TRANSFORMER PAD 75 TO 500 KVA

SCALE: 1/2" = 1'-0"

Colorado State University FACILITIES PLANNING, DESIGN AND CONSTRUCTION STANDARDS	DRAWING: E-2
	ELECTRICAL DIV. 26
TRANSFORMER PAD 75 TO 500KVA	