



**SLAB PLAN**

**NOTES**

1. CONCRETE TESTING, 3000 LBS. MIN. PER SQ/IN; 4% TO 6% ENTRAINED AIR, 3/4" MAX. SIZE AGGREGATE.
2. #4 REINFORCING STEEL, ATSM-A615 GRADE 60, PLACE APPROX. 6" O.C. EACH WAY AND SECURELY TIED TOGETHER.
3. MINIMUM CONCRETE COVER OVER REINFORCING STEEL 2" UNLESS NOTED.
4. WOOD FLOAT FINISH, LEAVING NO DEPRESSION.

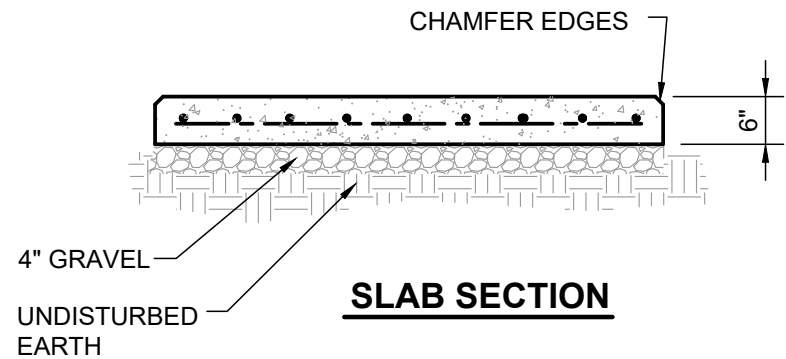

**SLAB SECTION**



**TRANSFORMER PAD 75 TO 500 KVA**

SCALE: 1/2" = 1'-0"

<b>Colorado State University</b> FACILITIES PLANNING, DESIGN AND CONSTRUCTION STANDARDS	DRAWING: <b>E-2</b>
	ELECTRICAL DIV. 26
<b>TRANSFORMER PAD 75 TO 500KVA</b>	