


NOTES:

FLOW METER AND BALANCE COCK
REQUIRED FOR EACH CHILLER AND PUMP

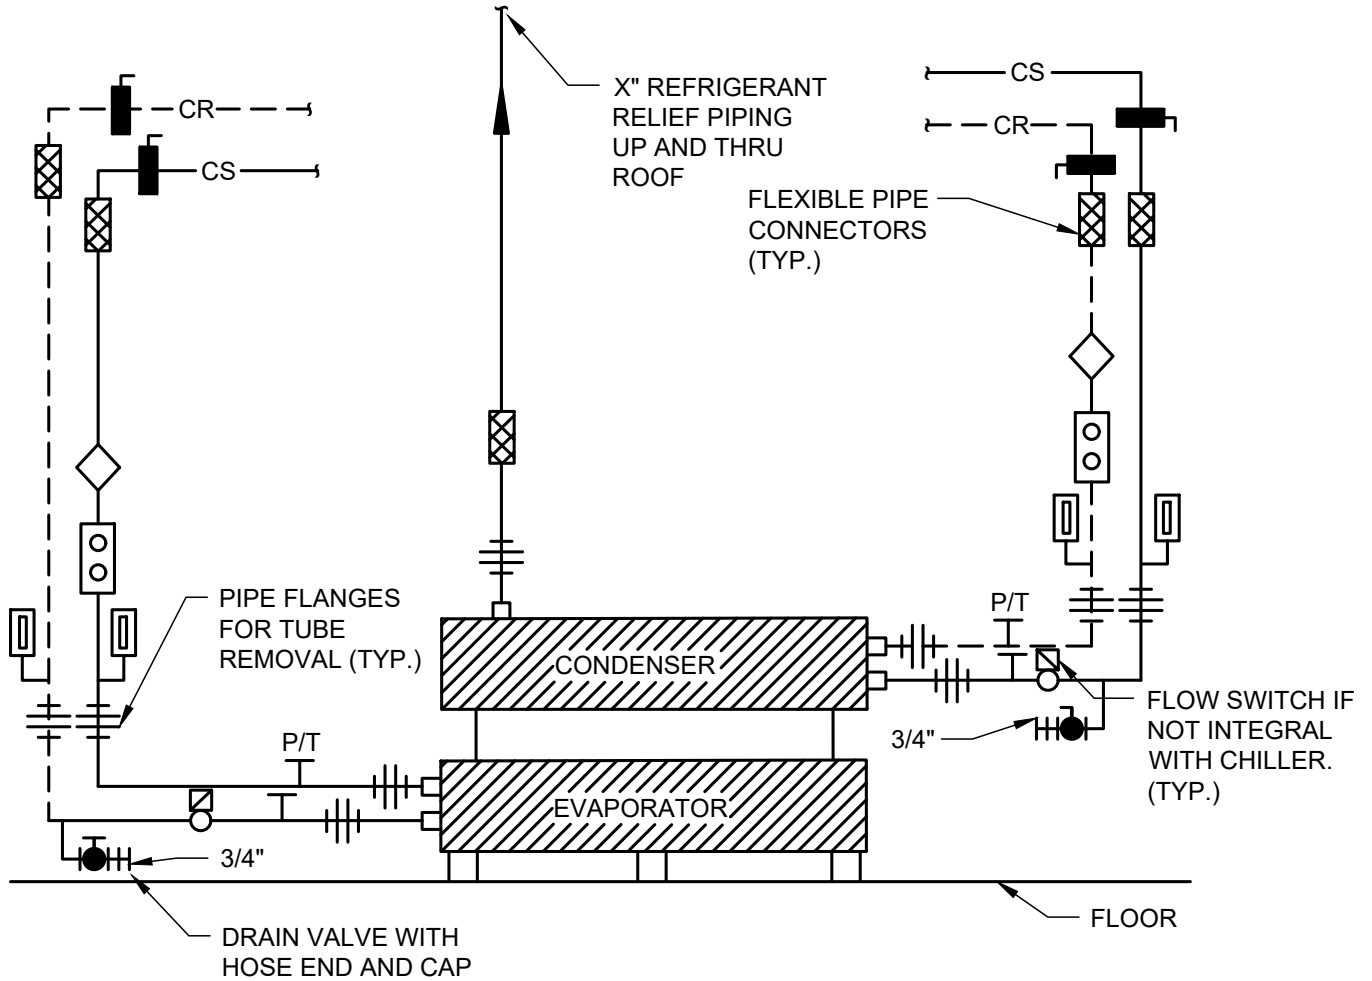

NOTES:

1. FLOW METER AND BALANCE COCK REQUIRED FOR EACH CHILLER AND PUMP.
2. POSITION PIPING TO ALLOW CLEANING OR REMOVAL OF TUBES AND HEADS.

Colorado State University FACILITIES PLANNING, DESIGN AND CONSTRUCTION STANDARDS	DRAWING: M-13
	DATE: 03/04/2021
CENTRIFUGAL CHILLER PIPING DETAIL	